





**Notes:**

1. Horizontal piping run in attic shown only for illustration. Stack could have penetrated straight upward through roof, if there were sufficient headroom to install fan at that location.
2. Electrical wiring to fan illustrated in later figure.

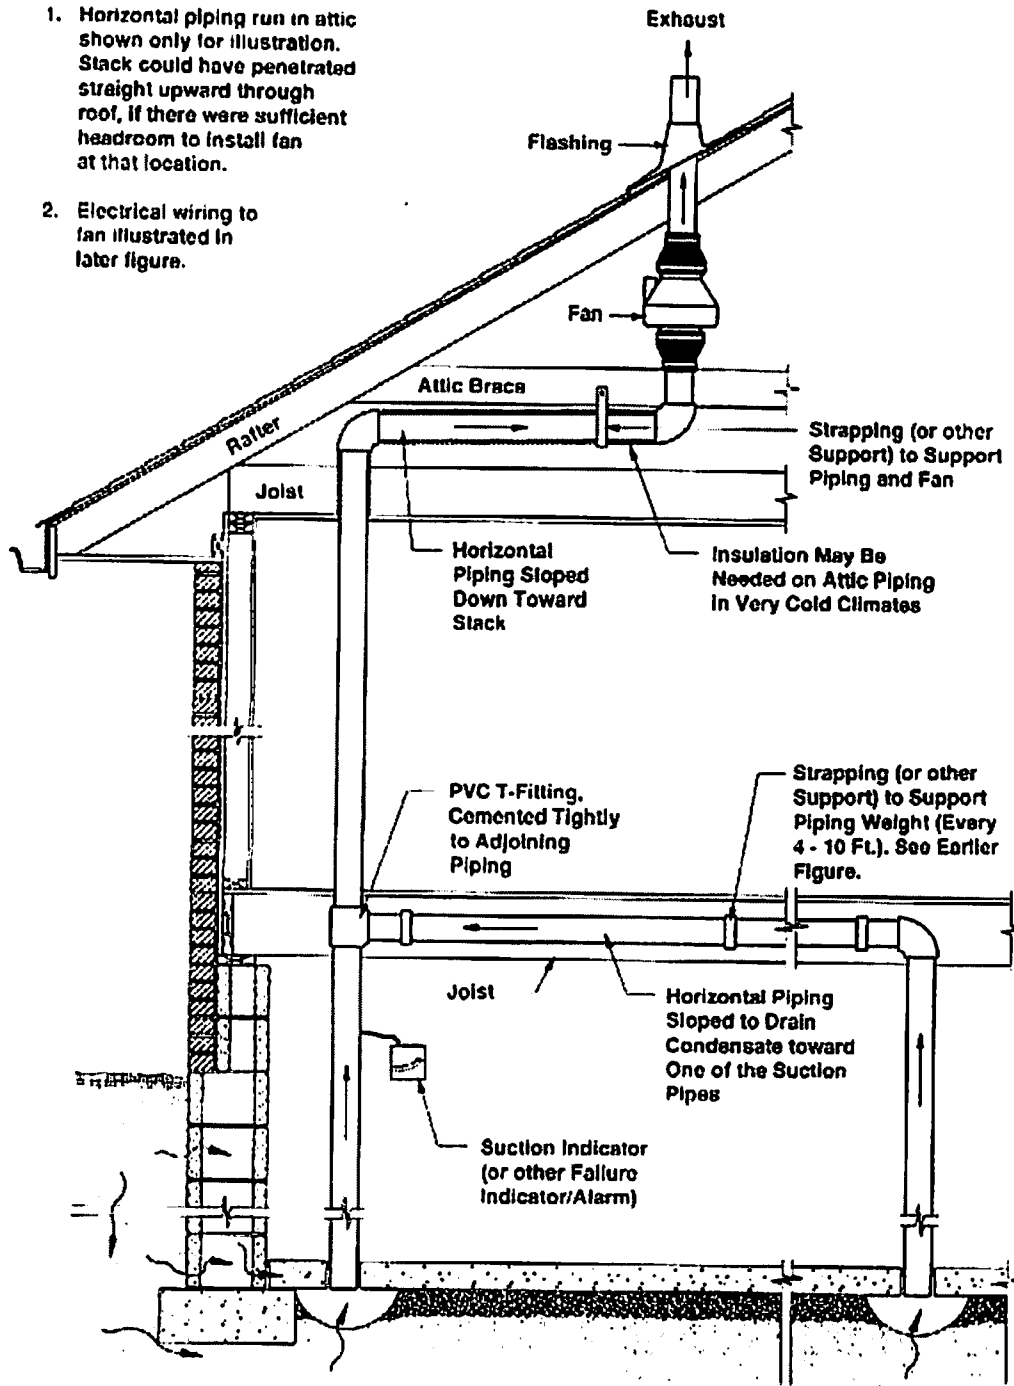

**1. Sample piping system using an interior exhaust stack.**

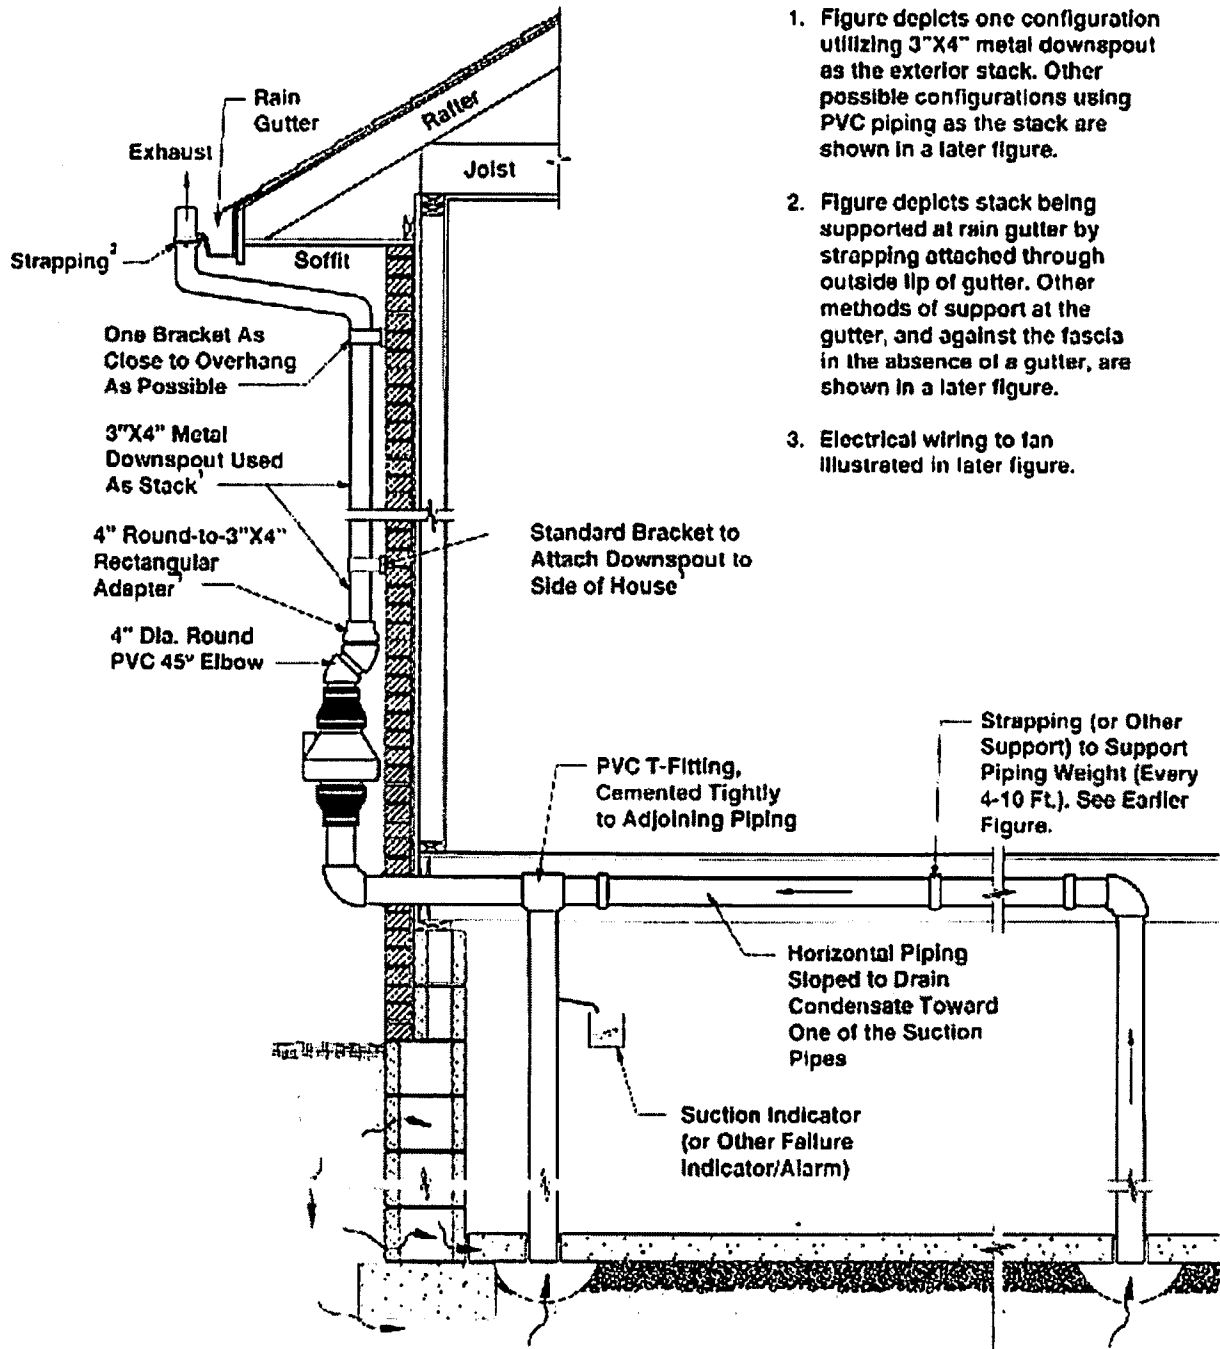

**Notes:**

1. Figure depicts one configuration utilizing 3"x4" metal downspout as the exterior stack. Other possible configurations using PVC piping as the stack are shown in a later figure.
2. Figure depicts stack being supported at rain gutter by strapping attached through outside lip of gutter. Other methods of support at the gutter, and against the fascia in the absence of a gutter, are shown in a later figure.
3. Electrical wiring to fan illustrated in later figure.

**2. Sample piping system using an exterior exhaust stack.**